



Originally Issued: 03/28/2014

Revised: 03/30/2017

Valid Through: 03/31/2018

**EVALUATION SUBJECT:
QUADFOAM® NATURESEAL 500****REPORT HOLDER:**

Accella Polyurethane Systems
100 Enterprise Drive
Cartersville, GA 30120
(770) 607-0755

CSI Division: 07 00 00 THERMAL AND
MOISTURE PROTECTION
CSI Section: 07 21 00 Thermal Insulation

1.0 SCOPE OF EVALUATION**1.1 Compliance to the following codes & regulations:**

- 2015, 2012, 2009 and 2006 International Building Code® (IBC)
- 2015, 2012, 2009, 2006 International Residential Code® (IRC)
- 2015, 2012, 2009 and 2006 International Energy Conservation Code® (IECC)

1.2 Evaluated in accordance with:

- ICC-ES AC377, approved April 2016

1.3 Properties assessed:

- Surface-burning characteristics
- Physical properties
- Thermal resistance
- Use in attics and crawl spaces

2.0 PRODUCT USE

QuadFoam® NatureSeal 500 is a spray-applied polyurethane foam plastic (SPF) insulation and is used as a nonstructural thermal insulating material in Type VB construction under the IBC and dwellings under the IRC. The insulation complies with IBC Section 2603, IRC Section R316, (2006 IRC Section R314) and IECC Sections C303, C402, R303 and R402 (2009 IECC Sections 303 and 402; 2006 IECC Section 402).

3.0 PRODUCT DESCRIPTION

3.1 QuadFoam® NatureSeal 500 Insulation: QuadFoam® NatureSeal 500 is a low-density spray-applied, open cell polyurethane foam plastic insulation having a nominal density of 0.5 pounds per cubic foot (8 kg/m³).

3.2 Surface Burning Characteristics

3.2.1 The QuadFoam® NatureSeal 500 foam plastic insulation, at a maximum thickness of 4 inches (102 mm) and a nominal density of 0.5 pounds per cubic foot (8.0 kg/m³), has a flame spread index of 25 or less and a smoke-

developed index of 450 or less when tested in accordance with ASTM E84.

3.2.2 Thicknesses are not limited for ceiling cavities and wall cavities when covered by a prescriptive thermal barrier (minimum ½ inch (12.7 mm) thick gypsum wallboard) complying with and installed in accordance with the IBC or IRC. Thicknesses of up to 11.5 inches (292 mm) for ceiling cavities and 7.5 inches (191 mm) for wall cavities are recognized, based on testing in accordance with NFPA 286, when installed in accordance with Section 4.3.2 of this report.

3.3 Thermal Resistance: For uses in accordance with the IECC or other codes, QuadFoam® NatureSeal 500 foam plastic insulation has a thermal resistance, R-value, at a mean temperature of 75° F (24° C) as shown in Table 1 of this report.

3.4 Intumescent Coatings: DC 315: DC 315 intumescent coating and DC315 Primer are manufactured by International Fireproof Technology Inc., and is a water-based coating supplied in 5-gallon (19 L) pails and 55-gallon (208 L) drums. The coating and primer have a maximum shelf life of 24 months when stored in factory-sealed containers at temperatures between 50°F (10°C) and 90°F (32°C).

Flame Control No. 60-60A: 60-60A is a water-based intumescent coating manufactured by Flame Control Coatings supplied in 5-gallon (19 L) pails and 55-gallon (208 L) drums. The coating has a maximum shelf life of one year when stored in factory-sealed container between 50°F (10°C) and 80°F (27°C).

4.0 DESIGN AND INSTALLATION**4.1 General**

QuadFoam® NatureSeal 500 spray-applied foam plastic insulation shall be installed in accordance with the manufacturer's published installation instructions and this report. A copy of these instructions and this evaluation report shall be available on the jobsite at all times during installation. Where conflicts occur, the more restrictive shall govern.

4.2 Application: QuadFoam® NatureSeal 500 shall be applied using spray equipment specified by Accella Polyurethane Systems

4.3 Thermal Barrier

4.3.1 Application with a Prescriptive Thermal Barrier: QuadFoam® NatureSeal 500 insulation at any thickness in ceiling cavities and in wall cavities shall be separated from

The product described in this Uniform Evaluation Service (UES) Report has been evaluated as an alternative material, design or method of construction in order to satisfy and comply with the intent of the provision of the code, as noted in this report, and for at least equivalence to that prescribed in the code in quality, strength, effectiveness, fire resistance, durability and safety, as applicable, in accordance with IBC Section 104.11. This document shall only be reproduced in its entirety.

Copyright © 2017 by International Association of Plumbing and Mechanical Officials. All rights reserved. Printed in the United States. Ph: 1-877-4IESRPT • Fax: 909.472.4171
web: www.uniform-es.org • 4755 East Philadelphia Street, Ontario, California 91761-2816 -- USA



ANSI ACCREDITED PLUMBING
MECHANICAL CERTIFICATION
2015



the interior of the building by a code-complying prescriptive thermal barrier. The IBC and IRC prescribe an approved thermal barrier of minimum ½-inch thick (12.7 mm) gypsum wallboard or equivalent 15-minute thermal barrier complying with IBC Section 2603.4 or IRC Section R316.4 (2006 IRC Section 314.4) as applicable and installed in accordance with applicable code.

4.3.2 Application without a Prescriptive Thermal Barrier: As an alternative assembly to the use of a prescriptive thermal barrier, QuadFoam® NatureSeal 500 insulation may be installed in accordance to one of the following methods:

DC315: QuadFoam® NatureSeal 500 insulation may be installed without a prescriptive thermal barrier when coated on all exposed surfaces with DC135 Primer and DC315 intumescent coating. The DC315 Primer shall be applied to a wet film thickness of 4 mils (0.102 mm) 3 mils (0.076 mm) dry film thickness and allowed to fully cure. DC315 intumescent coating is applied to the primed insulation surface at a 1.0 gallon / 100 ft² (0.4 L/m²) theoretical application rate to a thickness of 16 mils (0.406 mm) wet film thickness, 11 mils (0.279 mm) dry film thickness. The maximum thickness of the spray foam insulation is limited to 7.5 inches (190 mm) on vertical surfaces and 11.5 inches (292 mm) on overhead surfaces. Primer and coating shall be applied in accordance with International Fireproof Technology's installation instructions and this report. Where conflicts occur, the more restrictive shall govern. Surfaces to be coated shall be dry, clean, and free of dirt, loose debris and other substances. The primer and coating is applied in one coat with low-pressure airless spray equipment.

Flame Control 60-60A: QuadFoam® NatureSeal 500 insulation may be installed without a prescriptive thermal barrier when coated on all exposed surfaces with Flame Control No. 60-60A intumescent coating. 60-60A intumescent coating is applied to the insulation surface at a 1.25 gallon / 100 ft² (0.51 L/m²) theoretical application rate to a thickness of 20 mils (0.51 mm) wet film thickness, 13 mils (0.33 mm) dry film thickness. The maximum thickness of the spray foam insulation is limited to 7.5 inches (190 mm) on vertical surfaces and 11.5 inches (292 mm) on overhead surfaces. Coating shall be applied in accordance with Flame Control Coating's installation instructions and this report. Where conflicts occur, the more restrictive shall govern. Surfaces to be coated shall be dry, clean, and free of dirt, loose debris and other substances. The coating is applied in one coat using brush, roller or airless spray equipment.

4.4 Attics and Crawl Spaces: When installing QuadFoam® NatureSeal 500 in attics or crawl spaces and a thermal barrier is omitted in accordance with IBC Section 2603.4.1.6 or IRC Sections R316.5.3 or R316.5.4, installation shall comply with either Sections 4.4.1 or 4.4.2 of this report.

4.4.1 Application with a Prescriptive Ignition Barrier: When QuadFoam® NatureSeal 500 insulation is installed within attics and crawl spaces where entry is made only service of utilities, an ignition barrier shall be installed in accordance with IBC Section 2603.4.1.6 or IRC Sections R316.5.3 and R316.5.4 (2006 IRC Sections R314.5.3 and R314.5.4), as applicable. The ignition barrier shall be consistent with the construction type of the building.

4.4.2 Application without a Prescriptive Ignition Barrier: Where the spray-applied insulation is installed in accordance with Section 4.4.2.1 or 4.4.2.2 of this report, the following conditions apply:

- Entry to the attic or crawl space is only to service utilities, and no storage is permitted.
- There are no interconnected attic or crawl space areas.
- Air in the attic or crawl space is not circulated to other parts of the building.
- Attic ventilation is provided when required by IBC Section 1203.2 or IRC Section R806, except when an air-impermeable insulation is permitted in unvented attics in accordance with Section R806.4 of IRC. Under-floor (crawl space) ventilation is provided when required by IBC Section 1203.4 (2012, 2009 and 2006 IBC Section 1203.3) or IRC Section R408.1, as applicable.
- The foam plastic insulation is limited to the maximum thickness and density tested, as described in Section 4.3.2 of this report.
- Combustion air is provided in accordance with Section 701 of the International Mechanical Code® (IMC) (2006 IMC Sections 701 and 703).
- The installed coverage rate or thickness of coatings, if part of the insulation system, shall be equal to or greater than that which was tested.

4.4.2.1 Attics and Crawl Spaces: QuadFoam® NatureSeal 500 spray foam insulation may be spray-applied without a prescriptive ignition barrier to the underside of the roof deck to thicknesses not exceeding 11.5 inches (292 mm) and/or vertical surfaces to thicknesses not exceeding 7.5 inches (190 mm), as described in this section. When QuadFoam® NatureSeal 500 is installed as described in this section, no ignition barrier or coating is required.

Alternative: QuadFoam® NatureSeal 500 insulation may be covered on all exposed surfaces with an application of DC 315 intumescent coating and primer as described in Section 3.4 of this report. The DC315 Primer shall be applied to a wet film thickness of 4 mils (0.102 mm), 3 mils (0.076 mm) dry film thickness, and allowed to fully cure. DC315 intumescent coating is applied to the primed insulation surface at a 1.0 gallon / 100 ft² (0.4 L/m²) theoretical application rate to a thickness of 16 mils (0.406 mm) wet film thickness, 11 mils (0.279 mm) dry film thickness and DC315 intumescent coating shall be applied in accordance with International Fireproof Technology's installation instructions and this report. Where conflicts occur, the more



Originally Issued: 03/28/2014

Revised: 03/30/2017

Valid Through: 03/31/2018

restrictive shall govern. Surfaces to be coated shall be dry, clean, and free of dirt, loose debris and other substances. The coating is applied in one-coat with low-pressure airless spray equipment.

4.4.2.2 Use on Attic Floors: QuadFoam® NatureSeal 500 insulation may be installed exposed (no coating), without an ignition barrier up to a maximum thickness of 11½ inches (292 mm) between and over the joist in attic floors. The insulation shall be separated from the interior of the building by an approved thermal barrier complying with IBC Section 2603.4 or IRC Section R316.4 (2006 IRC Section 314.4). The ignition barrier required by IBC Section 2603.4 and IRC Section R316.5.3 (2006 IRC Section 314.5.3) may be omitted in this case.

5.0 LIMITATIONS

The QuadFoam® NatureSeal 500 spray foam insulation described in this report complies with, or is a suitable alternative to what is specified in those codes listed in Section 1.0 of this report, subject to the following conditions:

5.1 The insulation and coating products shall be installed in accordance with the manufacturer's published installation instructions, this evaluation report and the applicable code. Where conflicts occur, the more restrictive shall govern.

5.2 QuadFoam® NatureSeal 500 insulation shall be protected by a 15-minute thermal barrier in accordance with Section 4.3.1 of this report except when installation complies with Section 4.3.2 (Application without a Prescriptive Thermal Barrier) or 4.4 (Attics and Crawl Spaces) of this report.

5.3 The A and B components of the insulation are produced under a quality control program with inspections by IAPMO Uniform ES.

5.4 QuadFoam® NatureSeal 500 insulation shall be installed by contractors certified by Accella Polyurethane Systems.

5.5 When QuadFoam® NatureSeal 500 insulation is used in areas where in the likelihood of termite infestation is "very heavy," it shall be installed in accordance with IBC Section 2603.8, (2012 IBC Section 2603.9) or IRC Section R318.4 (2006 IRC Section R320.5), as applicable.

5.6 Jobsite labeling and certification of the insulation shall comply with 2015 IRC Sections N1101.10 and N1101.10.1.1, 2012 IRC Sections N1101.12 and N1101.12.1, IRC Sections N1101.4 and N1101.4.1 and IECC Sections C303.1.1 and C303.1.2 (2009 IECC Section 303.1.1.1; 2006 IECC Sections 102.1.1 and 102.1.1.1), as applicable.

5.7 Where applicable, QuadFoam® NatureSeal 500 shall be installed with a vapor retarder in accordance with the applicable code.

5.8 Use of QuadFoam® NatureSeal 500 insulation under this report is limited to Construction Type VB.


6.0 SUBSTANTIATING DATA

6.1 Data and test reports submitted are from laboratories in compliance with ISO/IEC 17025 and in accordance with the ICC-ES Acceptance Criteria for Spray-applied Foam Plastic Insulation, (AC377), Approved April 2016, including reports of tests in accordance with Appendix X of AC 377.

6.2 NFPA 286 test reports dated May 9, 2013 and April 17, 2015.

7.0 IDENTIFICATION

Containers of QuadFoam® NatureSeal 500 components are identified with a label bearing the Accella Polyurethane Systems name address; the product trade name (QuadFoam® NatureSeal 500); the lot number; the flame spread and smoke developed indices; mixing instructions; density; the shelf life; the expiration date; and the IAPMO Uniform ES Evaluation Report number (ER-285).

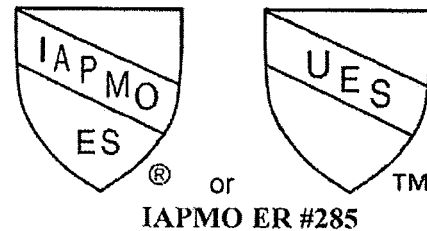

Brian Gerber

Brian Gerber, P.E., S.E.
Vice President, Technical Operations
Uniform Evaluation Service

Richard Beck

Richard Beck, PE, CBO, MCP
Vice President, Uniform Evaluation Service

Russ Chaney
GP Russ Chaney

CEO, The IAPMO Group

For additional information about this evaluation report please visit
www.uniform-es.org or email at info@uniform-es.org



Table 1—Thermal Resistance (R-Values)¹

Thickness (inch)	R-Value (°F·ft ² ·hr/Btu)
1.0	3.7
4.0	14
7.5	27
11.5	41

SI: 1 inch = 25.4 mm; 1 °F·ft²·hr/Btu = 0.176 °K·m²·hr/W

¹R-values are calculated based on tested k-factors at 1- and 4-inch thicknesses.